

Caution

Do not store
combustible materials
near to this equipment

ing any item
which are li
amage by im

for further information ple
www.esc.org.uk

Honeywell

IMPORT
000469 kWh

PB3CABYCT-ZK

No- K22W004097

3 x 230 / 400V

3 x 0.05-5(6)A 50Hz

0.2 varh/imp 0.2 Wh/imp

-25°C to 55°C

2-02004-D

2022

Cl.B EN50470 Cl.2 IEC 62053-23

CE M22 0122


0120/SGS0024

Elster Rometrics S.R.L.
DJ691, km 8+775m, TAP
307210 Giarmata, Romania

0.2 varh / imp

0.2 Wh / imp

PB3CABYCT-ZK

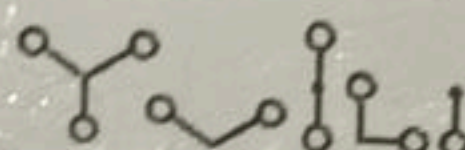

Cl. 1.0

IEC 62053-21

Cl. 2.0

IEC 62053-23

3 x 230 / 400V


3x5(6)A

50Hz

PROPERTY OF :-

E.ON

K22W004097

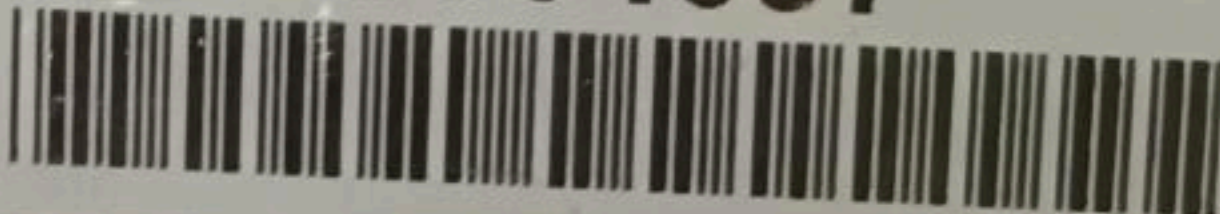

Li

Multi
Comp

LVCT 2400/S
CP31NEX

CP31NEX CHECK
ID002

e-on

Honeywell

A1700i

IMPORT
000469

PB3CABYCT-ZK
No- K21W005574

3 x 230 / 400V
3 x 0.05-5(6)A
0.2 varh/imp
-25°C to 55°C
2-02004-D
CI.B EN50470 CI.2 IEC 62053-23


CE M21 0122

0120/SGS0024
Elster Rometrics S.R.L.
DJ691, km 8+775m, TAP
307210 Giarmata, Romania

0.2 varh / imp

0.2 Wh / imp

PB3CABYCT-ZK

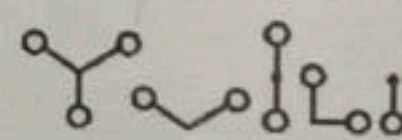

CI. 1.0 IEC 62053-21
CI. 2.0 IEC 62053-23

3 x 230 / 400V
3x5(6)A
50Hz

PROPERTY OF :-
E.ON

K21W005574



-||-Li

Multi Utility
Compatible

LVCT 2400/S
CPSINEX


MAIN 1000
04

On

e-on

ELECTRICITY METER INSTALLATION

THE METER HAS BEEN CHECKED &
IDENTIFIED FOR CORRECT POLARITY

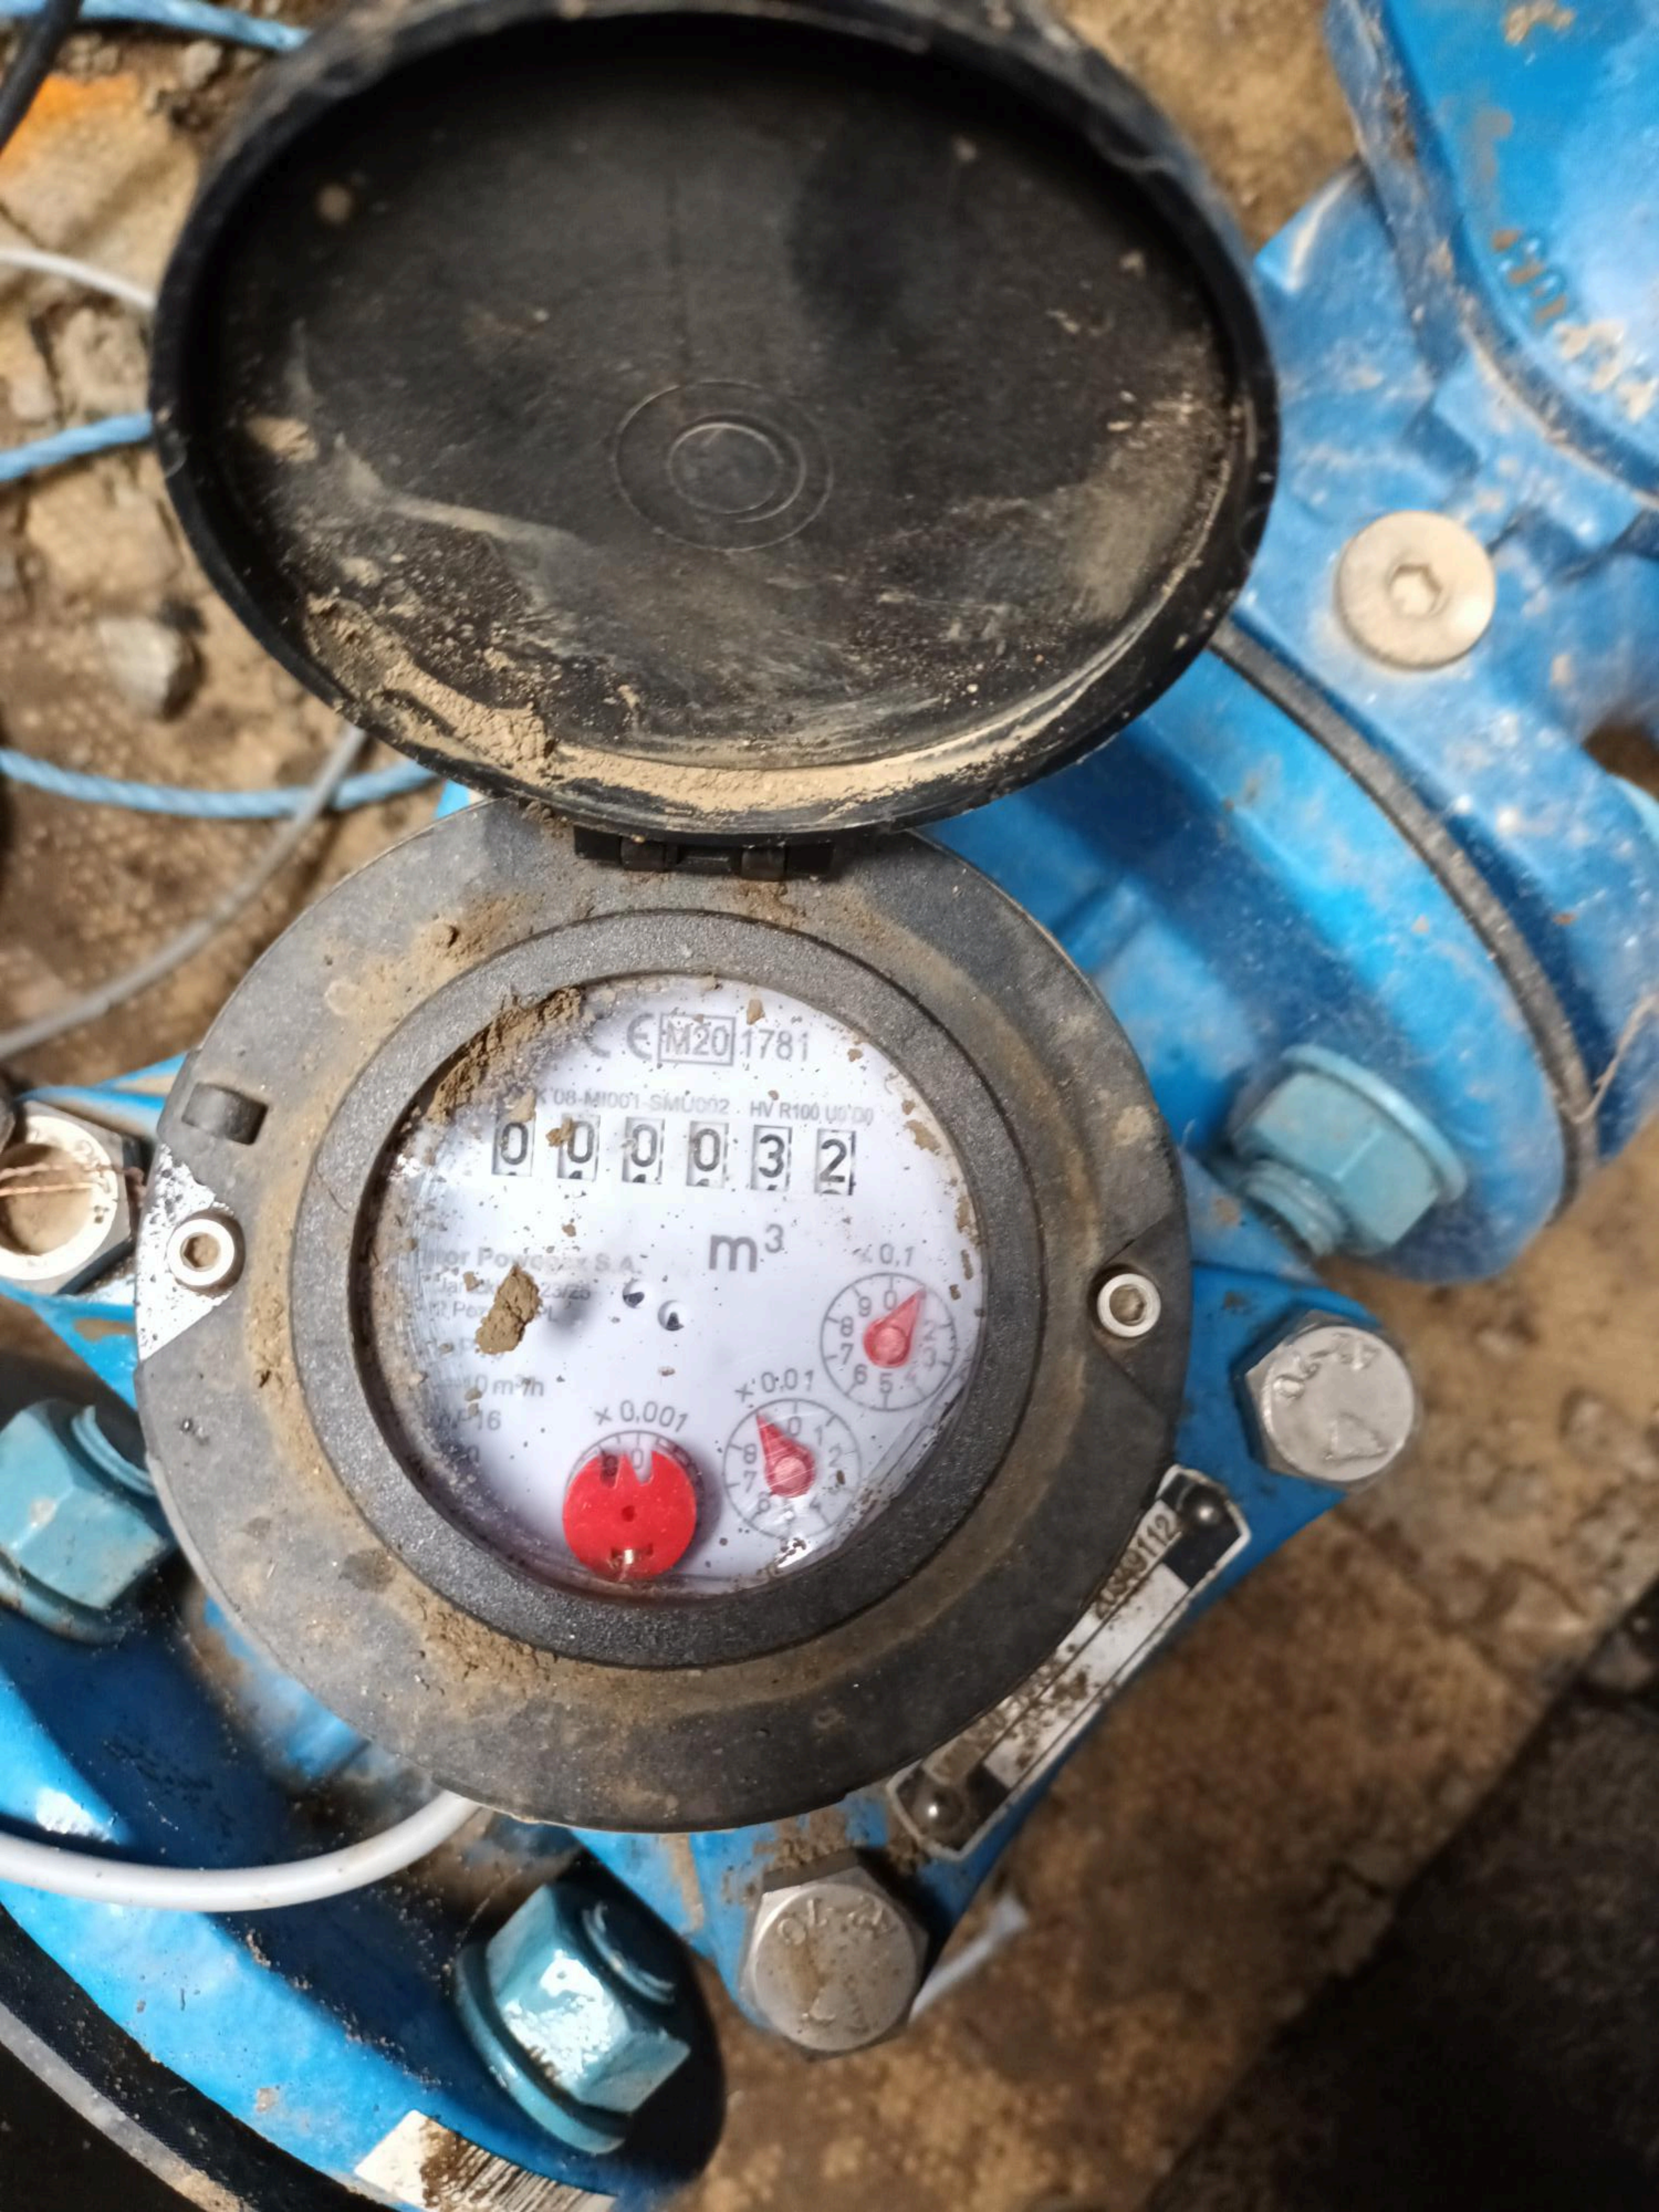

M20 1781

000032

m³

0.1

0.01


0.001

01/12



Relay

PadPuls M2



www.relay.de



U0-L0
METERS
R100H1 R50VH
000024 m³
T50 CE M 21 1383

IWM-PL3

IP68

SN 21610240



BOSS

PULSE WIRES:

WHITE/GREEN

K=100

4 X 0.25

ICO LHY